



Lever for attaching the air treatment unit.
The unit is mounted 80mm lower, when compared to a normal setup.

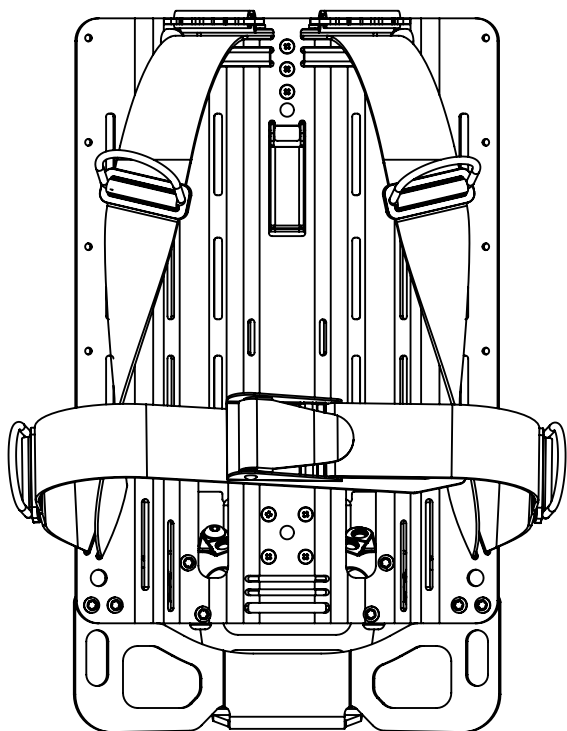

Elongated backplate



Á
Á

Remount all components from the previous configuration to the elongated backplate except for MP and HP hoses.


Do not use the inflator hose (878mm), the oxygen manual add hose (830mm), ADV (798mm), and both pressure gauges (929mm) will not be used.

The Old 960mm diluent hose will be used as the inflator hose.


For the ADV, oxygen manual, diluent manual, and pressure gauges, use hoses that are 80 mm longer than the original ones.

The head oxygen inlet hose (436mm) stays the same.



The routing and connections of the hoses to the ports of the first stages are displayed on the pictures bellow and on the following pages.

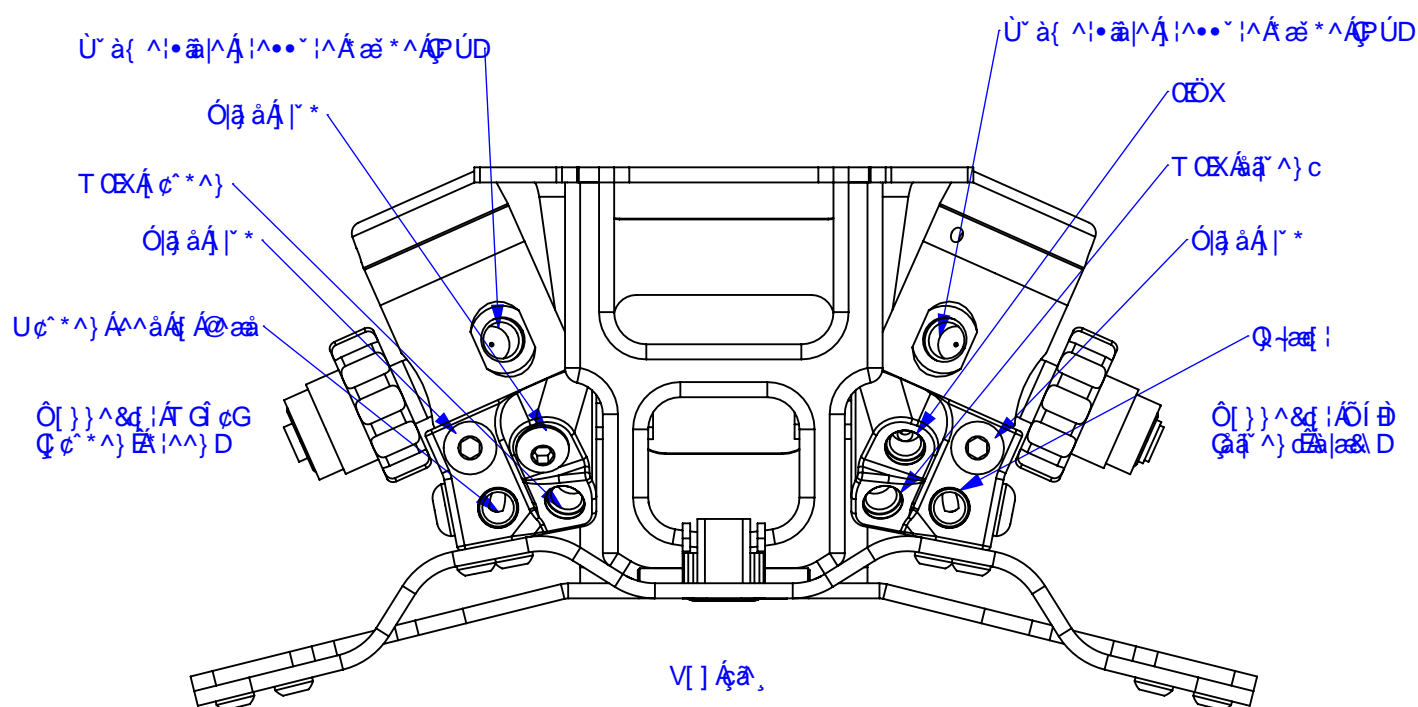


Á
Á
Á

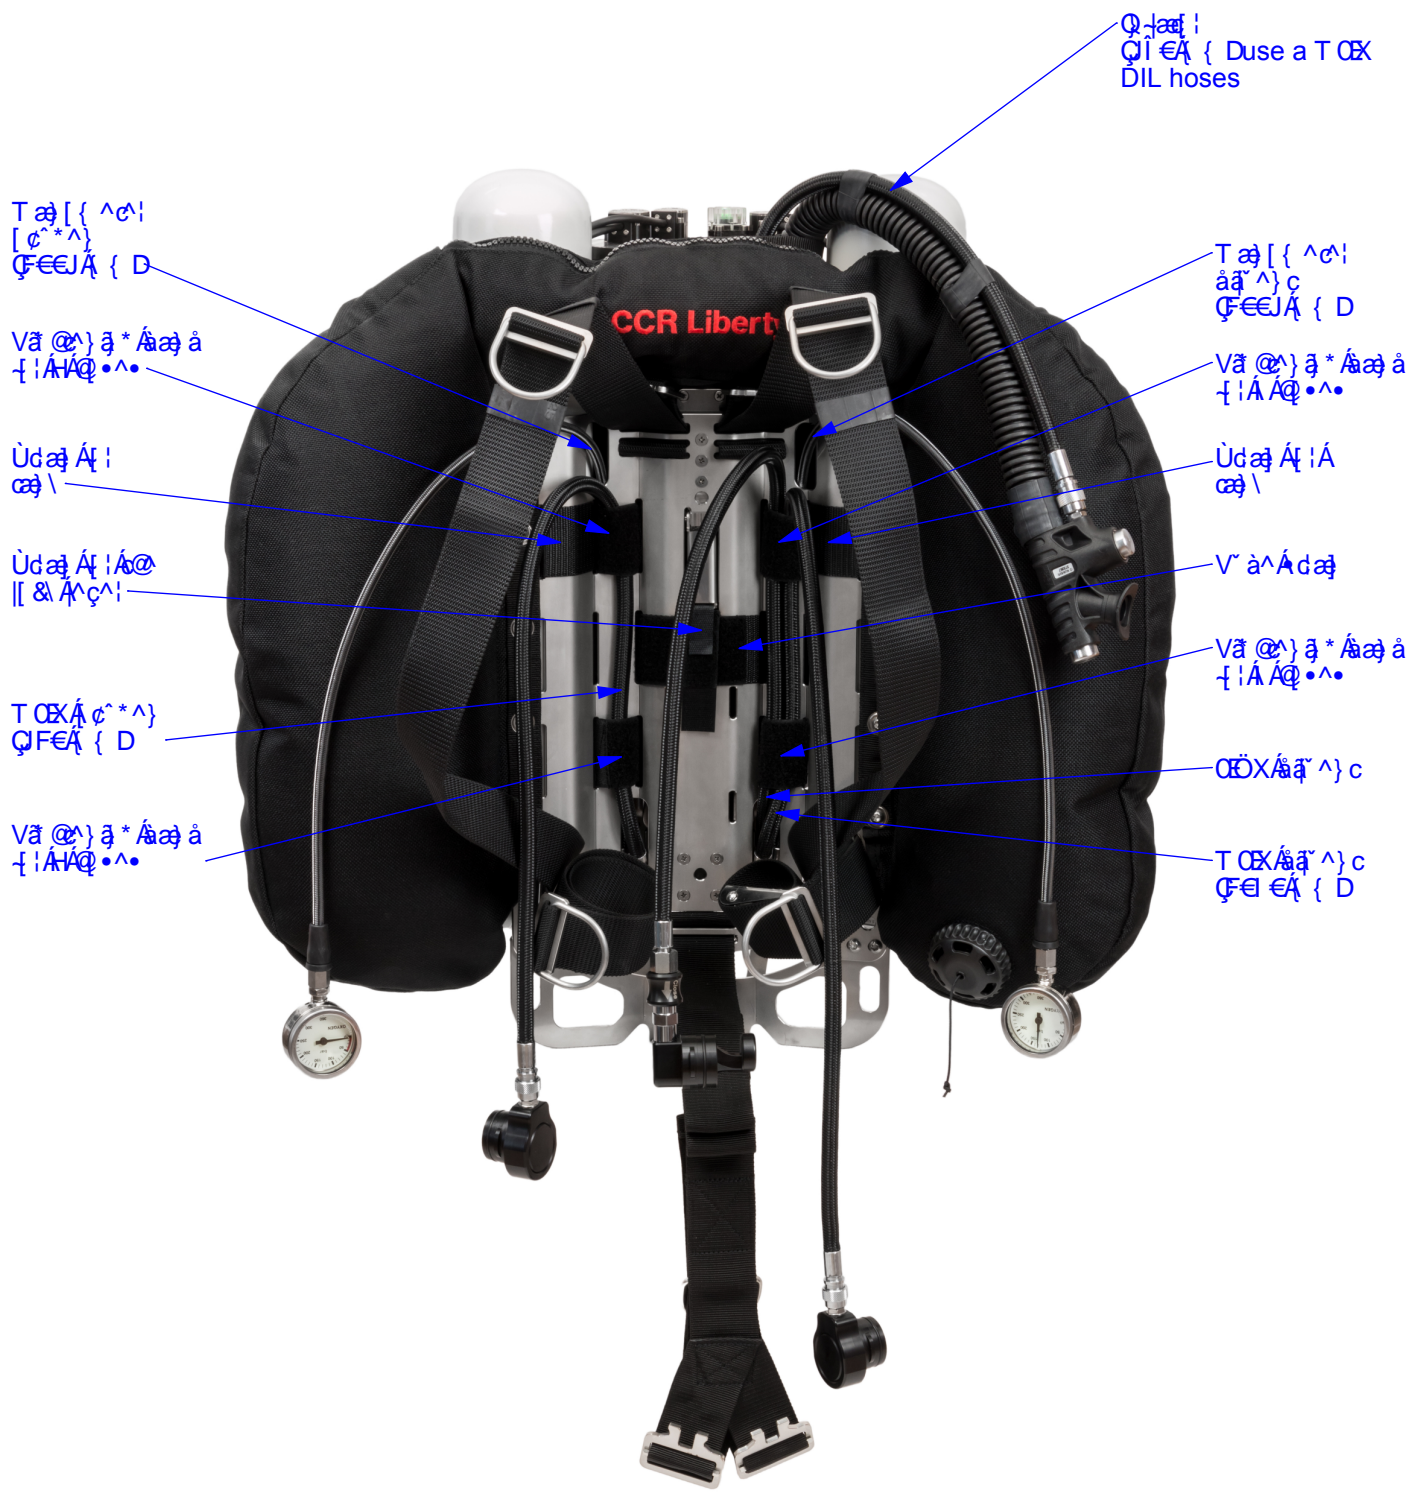

 **Liberty**

Wj ā { {			Ù æ Ā Ā FIK	Ù ā ^ OĒ	Ù @ ^ c HĀ - Ā	Ö æ ^ FJĒ OĒ Ī
----------	---	---	-------------	----------	----------------	----------------

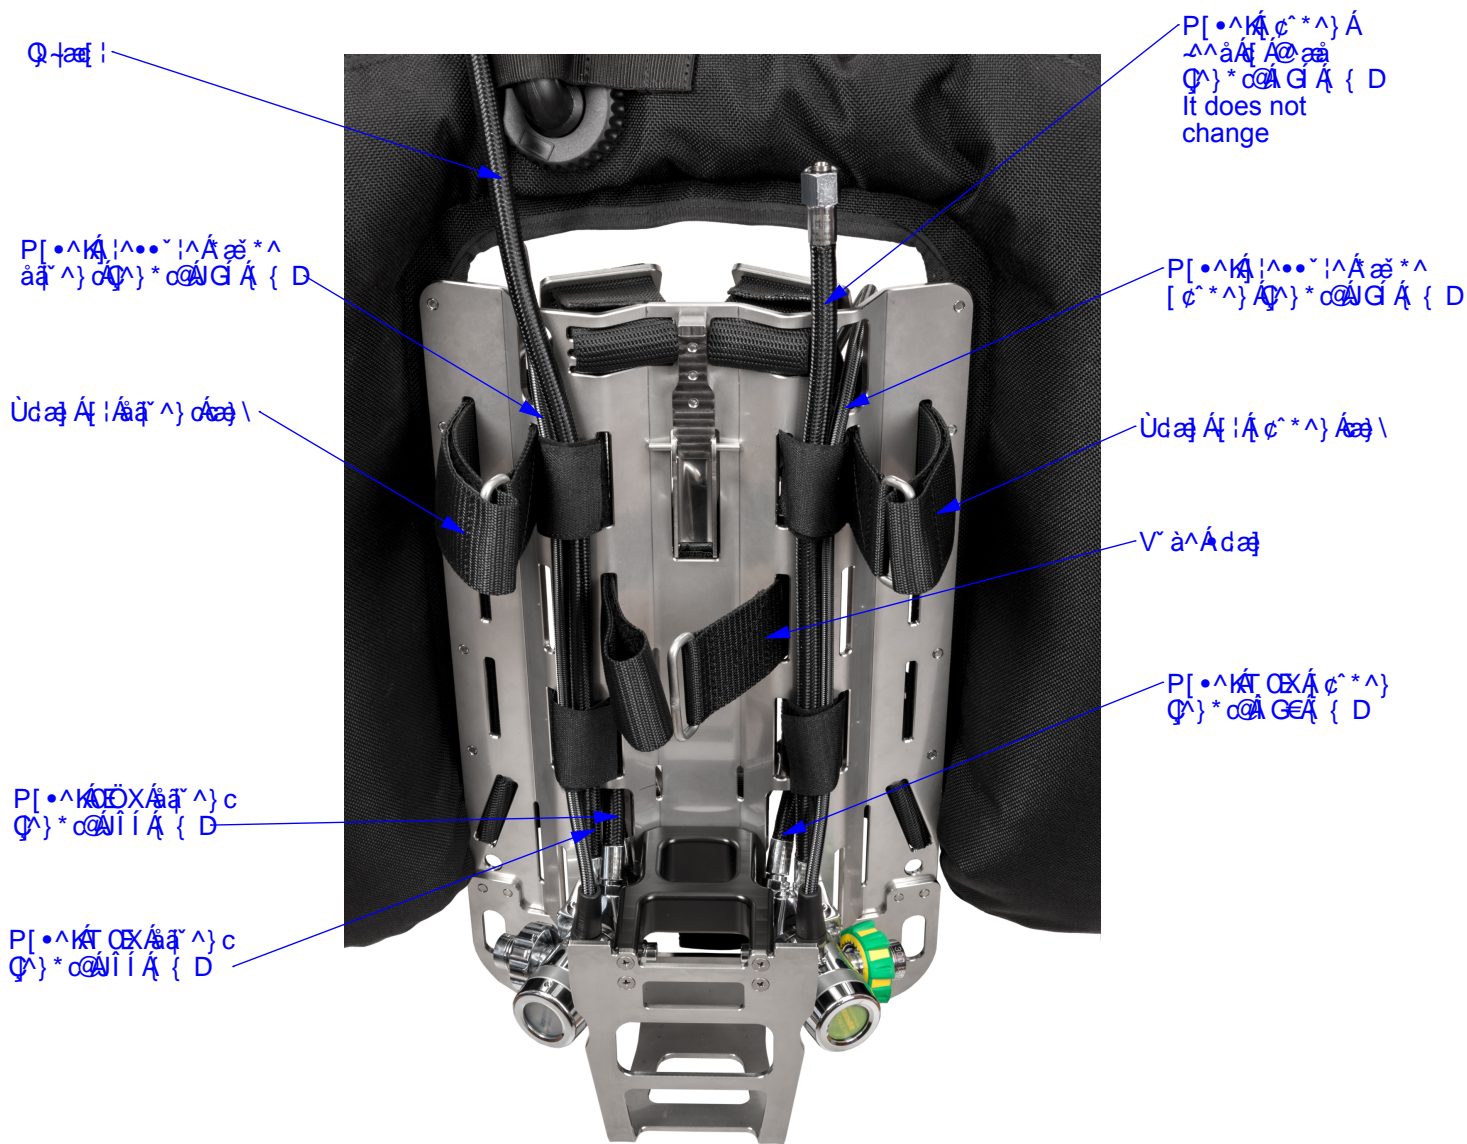



ŌĀ~ àà^!Āā * Ā ~ • ōĀ^ĀĀ } Ā
ō@Ā dāġ Ā^c ^^} Ā@/ŌĒāġ * Ā
āġ āĀ@Āāāā] |æ^

Ū@~ |ā^!ŌĒāġ * • Āā^Ā
āāāā@āĀĪ ĒĀ { Āē āĒ Ā
~[{ Ā@Āāāā] |æ^

Ūā^ĀŌĒāġ * • Āā^Ā
āāāā@āĀĪ ĒĀ { Āē āĒ Ā
~[{ Ā@Āāāā] |æ^

V@Ā dāġ Ā Ā^Āā@~ * Ō
ō@Āāāā] |æ^ Āġ Ā@ĀĪ cāĀ
Ĳ * ŌĀ Ā ĠĒ {

V@Ā~ & |^ĀĀ |āā^āĲ } Ā@Ā
Ĳ-ō dāġ ĀĪ Ē { Āē āĒ ĀĲ { Ā
ō@Āāāā] |æ^



V@Ā & | Ōō dāġ Ā
āĀ [Ō @, } ĀĲ Ā
&āāā

V@Ā dāġ Ā ~ • ōĀ^Ā āāā
ō@Ā āĒ ĒĲ āāā * ĀĲ@Ā
[Ō@Ā āĒ Ā @ } Ā^āā * ĀĀ
ō@Ĳ ~ * Ō@Āāāā] |æ^ ĀĀ
ā & |^Ā&Ē

Ūā Ōō dāġ Ā āāāā@āĀĪ Ā
ō@Ā-ōĲ } ^Ā Ō&Ĳ } ŌĲ Ā@Ā
ā & |^ĀĀ ŌĲ āĲ |^ā

V@ĀĲ |āĲ Ā@Ā dāġ Ā Ā^Ā& |^āĀ
āāāā~ āā^!Āā * ĒĲ Ō&Ĳ Ā^Ā
Ĳ āāāāā~ |^Ā ŌĲ ā

V@Ā~ { ^!āāāāā~ Āā^ĀĲ |ĀĲ āĲ ĀĲĒ& ĀāĲĒāĲ
āāāāā~ āā^ĀĲ āāāāā~ Āā^ĀĲ āāāāā~ Āā^ĀĲ āāāāā~

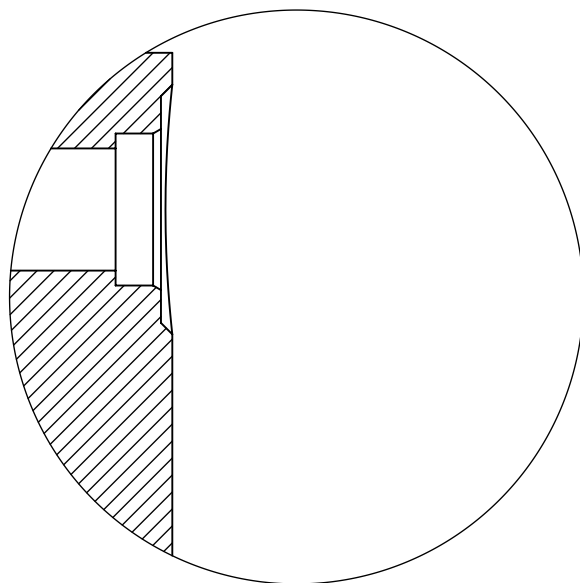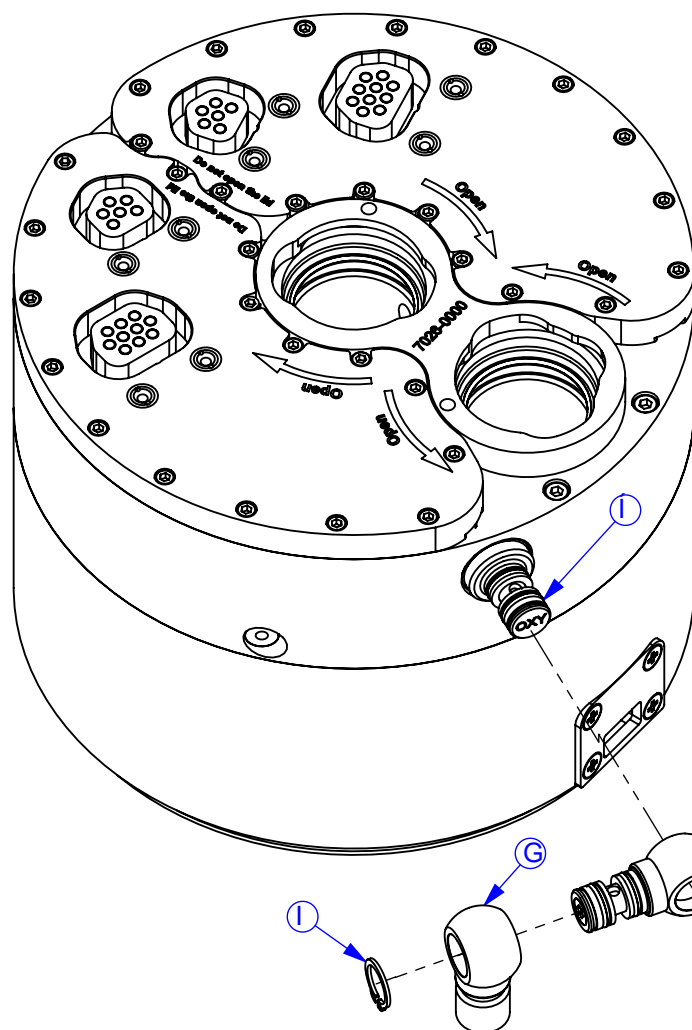


K jh h.Y.YI hYbXYX VUW_d`UhZh.Y`cl m[Yb`jg fci hYX Zfca `U`XjZZYfbhXjFYWjcb`h`Ub`i`g`U`fgY`bYi`hdU[YL`H`jg`jg`k`m`
Ub`YI`hYbXYXf(A)A`Ug`hc`VY`d`UWX`VYfk`YYb`h.Y`VUb`c(A)G`AbX`h.Y`VcbbYVh(A)I`Eä

FYa c j Y h Y g Y Y [Y f f] b [Á F Á k] h ' d '] y f g U b X ' f Y a c j Y Z c a ' h Y V e b b Y V c f Á ① Á h Y V U b ' c Á G Á b g h U X ' c Z] h d i h h Y ' Y I h b X Y f Á H Á b b h Y V e b b Y V c f Á ① Á y W f Y] h k] h ' U g Y Y [Y f f] b [Á F Á h U W h Y V U b ' c Á G Á c h Y Y I h b X Y f Á H Á b X g y W f Y] h k] h ' U g Y Y [Y f f] b [Á ① Á Y g Y Y [Y f f] b [g ' U f Y ' h Y ' g U a Y L'

H.Y.VzbbYVcfUbxH.Y.YIHybXYFUFYUgnaaYhfVZhYm\UjYU"Uf[YF*Ubx'gaU'YfVXuazYf'cb'h.Y]f'\c'Yg"H.Y'd]YW'aighVY'cf]Ybh'X'gc'h.Y'\c'Y'k]h'h.Y'gaU'YfVXuazYf'aighVY'cf]Ybh'X'f'ckUfXg'h.Y'gY[Yf'f]b["

5rhUM h.Y gYY[Yf]fb[gWfYZ ``mk]h d`YfgZcdYb`h.Ya`k]h WfYZUg`hc`bchXYZcfa`h.Ya zWf gfb[`h.Ya`hc`ghUm
dYfa UbYbhmc dYbYX``z`h]g`UddYbgZc`bchfmc Z] h.Y f]b[zi gY`U`bYk`cbY`fU`gdUFY`f]b[`]g]bWf YXXE`






Đáp án

Đáp: $K \in G$

 $\tilde{A} \in \{\tilde{a}, \tilde{b}\}^N$

Đã & đã

Y ^ã @M Fì ì í È í Á*

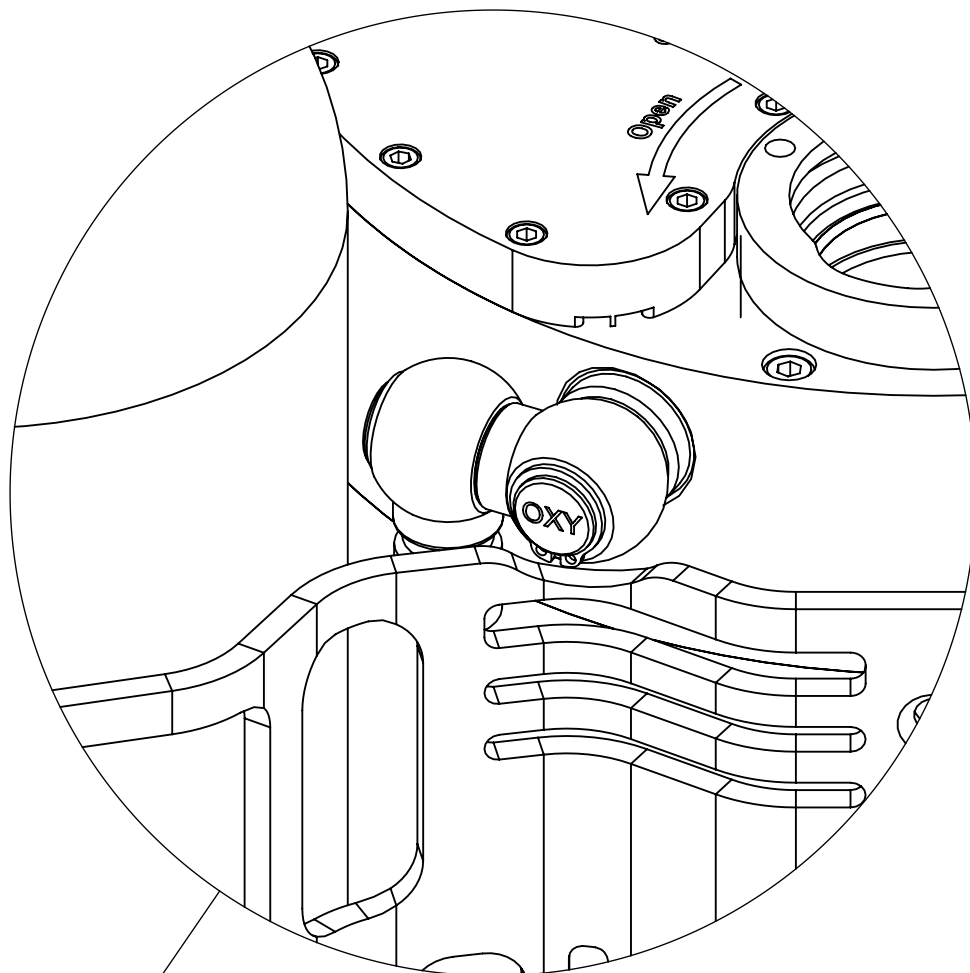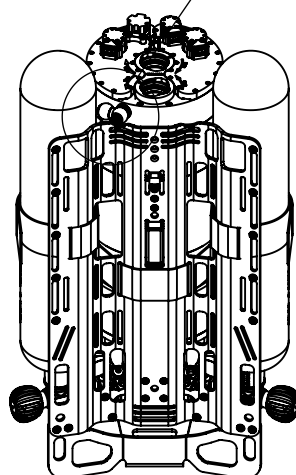

Á
Á
Ä & \ KÄ